

Fire Bead® Submittal Sheet

STOCK NO.	LENGTH	PCS. PER BOX
9250 - 1hr	10'	30
9260 - 2hr	10'	22

Description: Trim-Tex® Fire Bead is a fire rated wall mount deflection bead that provides 1- and 2-hour fire-ratings for both dynamic and static joints according to UL-2079 5th Edition (for both standard walls and shaft walls) and is sound tested according to ASTM E90. Sound Reports available upon request.

- Fire Bead provides BOTH 1- and 2-hour fire ratings.
 - The 1-hour profile has a 1/2" gasket with a 5/8" flexible horizontal return leg.
 - The 2-hour profile has a 1/2" gasket with a 1 1/4" flexible horizontal return leg.
 - Provides an L-rating less than 1 CFM/Lin Ft for ambient and 400 degrees F.
- Fire Bead is installed fully cured, is not affected by water or moisture and has no temperature restrictions for installation.
- Fire Bead has 2 separate compressible sealing points, one against the concrete deck and one against the framing member to prevent sound flanking.
- Fire Bead has a pink perforated mud leg to indicate to the installer and inspector that the vinyl accessory is fire rated.
- Fire Bead will stay flexible for the life of the assembly.

Advantages: Made from rust proof, dent resistant PVC to reduce jobsite and handling damage. Does not contain cellulose, a potential food source for mold. Intumescent tape expands when exposed to flame for increased fire protection.

Limitations: Product is designed for interior use.


Surface Characteristics: Trim-Tex® products are made from PVC. PVC does not support combustion and is self-extinguishing when the source of flame or heat is removed.

Installation: Ensure wall sections are built to UL 2079 specifications. Detailed installation instructions can be found at www.trim-tex.com.

Accessories: Safety Products distributed by Trim-Tex® .

ASTM & Code Standards:

- ASTM E 1966: Standard Test Method of Fire Tests of Firestop Systems – UL 2079 5th Edition Tests for Fire Resistance of Building Joints.
- ASTM E-119 Standard Test Methods for Fire Tests of Building Construction and Material.
- UL ER25033-01
- Sound Tested in accordance with ASTM E90-09.
- Air leakage tests conducted for compliance with Section 713.6 of IBC and CBC.
- Intumescent Firestopping tested per ASTM E 84 UL723, Flame Spread 5, Smoke Index 5.
- UL listings/approvals – HW-D-0624; HW-D-0625; HW-D-0554; HW-D-0550; BW-S-0024; WW-D-0104.
- U.S. Pat. 11,111,666

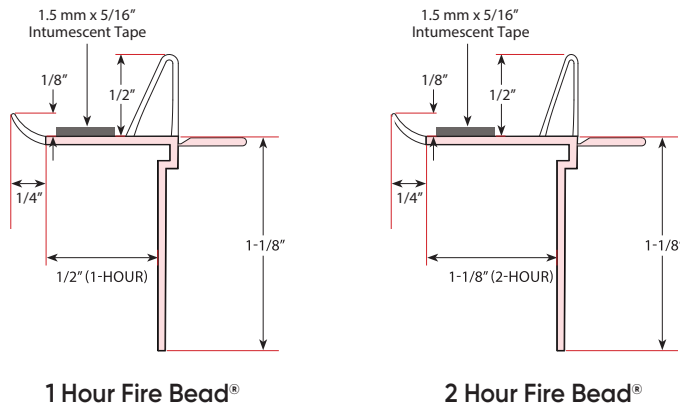

Job Name _____

Contractor _____

Date _____

Approvals (Signatures or Stamps)